


Date	Notes	By

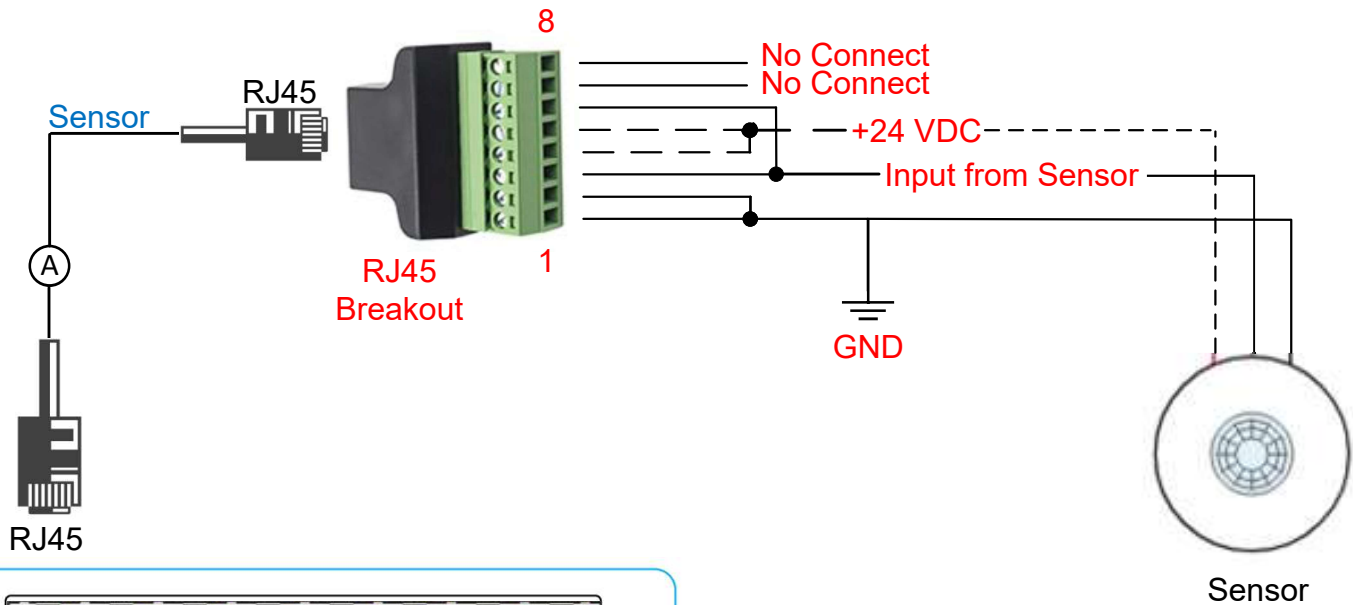

CH 1

CH 2

CH 3

CH 4

EM TEST

1

2

3

4

5

6

7

8

SDCnet

RELAY1

RELAY2

ETH

SDCnet

RELAY3

RELAY4

USB/EM

SmartTM

DC Lighting

SDCS CIO

smartdclighting.com

Connect to SDCnet and PDnet Only!

Class 2, Class B Power Source

Max AmbientTemp 113F (45C)

Dry Locations Only; Not Plenum Rated

CSA C22.2 No. 141, Emergency Lighting Equipment

UL60730-1, CAN/CSA E60730-1

UL924, UL2108, CSA C22.2

Patent Pending, Made in the USA

UL

5016831

SP

IP20

PDnet

SDCnet

SDCnet

RELAY1

RELAY2

ETH

WIRE LEGEND	
	CAT 5-E (CLASS 2)

Revision Drawn By Date Level Approved	A2	 13450 EM 529 RD HOUSTON, TX 77041	A	
	DVR			
	06/30/25			
	REL1			
	No scale	SDCS CIO TO SENSOR		

Tols:
.x = 0.25"
.xx = 0.10"