
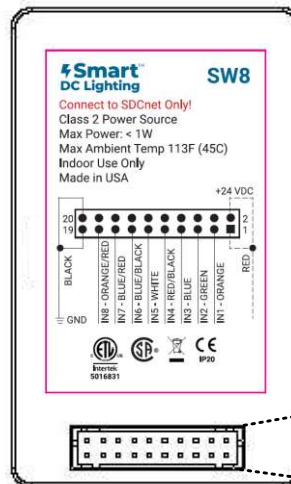


Date	Notes	By



To additional  
SDCnet Devices  
Max of 16 SDCnet  
devices per SDCS  
CIO and 250' max  
distance

SDCnet IN & OUT  
Interchangeable

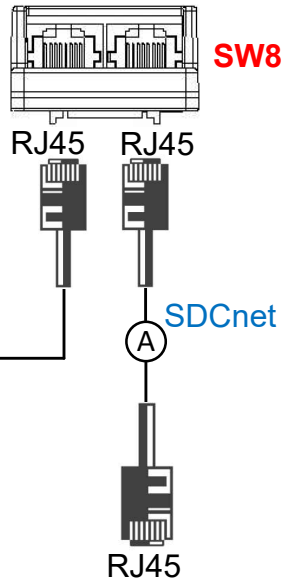

Up to 8 Switches

Pinout Detail  
For provided Cable

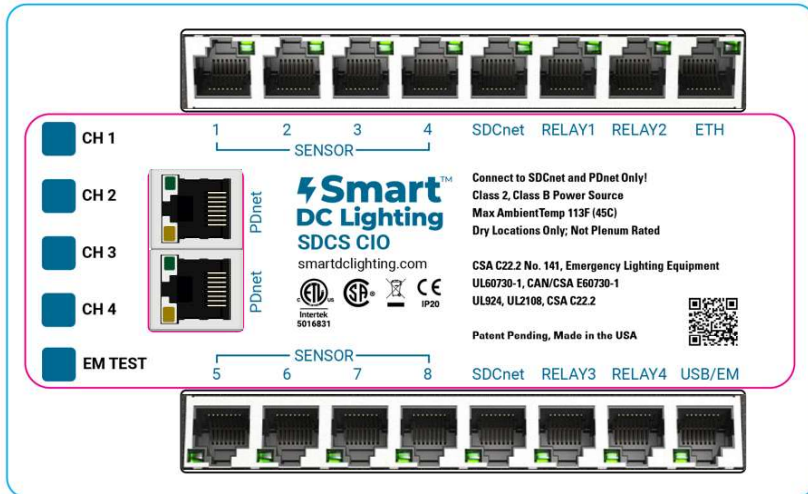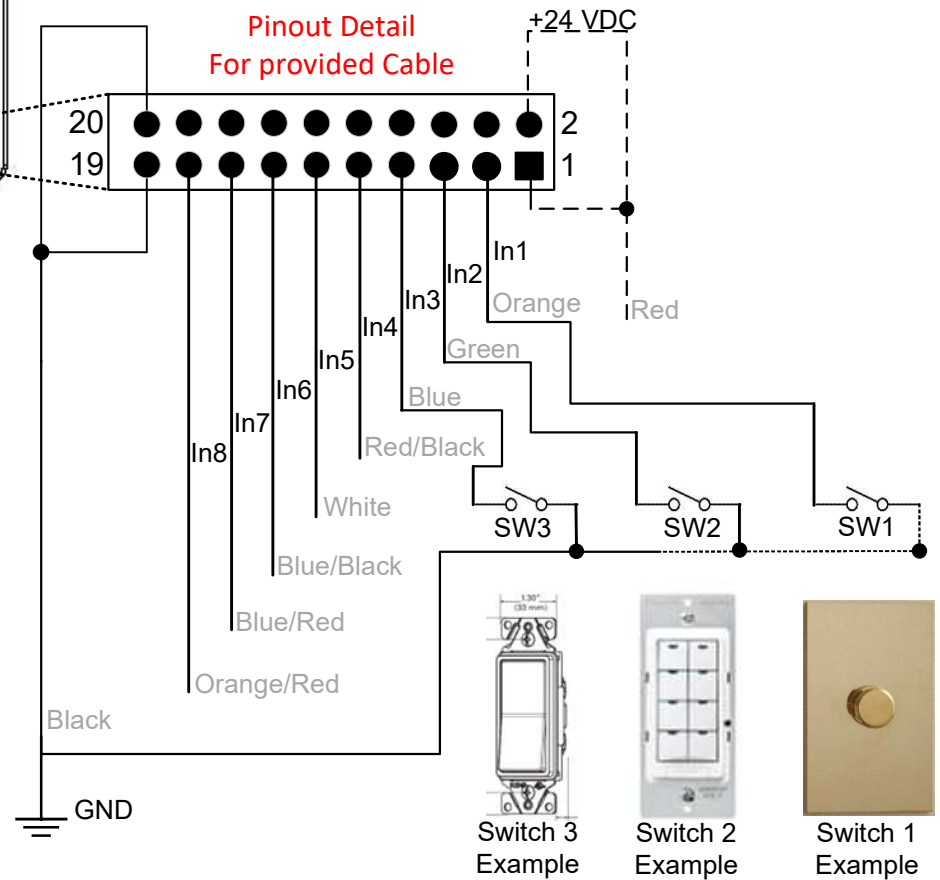

## WIRE LEGEND

— (A) — CAT 5-E (CLASS 2)

Revision	A2
Drawn By	DVR
Date	06/30/25
Level	REL1
Approved	No scale

Tols:  
.x = 0.25"  
.xx = 0.10"

**Smart™  
DC Lighting**  
13450 EM 529 RD  
HOUSTON, TX 77041

A

SDCS CIO TO SW8